

**5-1/4" AMERICAN-DARLING® B-62-B-5 FIRE HYDRANT
BY AMERICAN FLOW CONTROL®**



AMERICAN
FLOW CONTROL
THE RIGHT WAY

CONSTRUCTION

Fully complies with ANSI/AWWA C502 and is available UL Listed and FM Approved in applicable configurations.

ONE-PIECE BRONZE OPERATING NUT

Removable pipe plug to allow lubrication of operating threads.

TRAVEL STOP NUT

Limits rod travel and helps eliminate rod buckling. Protects interior coating by preventing valve bottom contact with base.

HYDRANT ROD

Upper and lower rods are connected by gray iron coupling using stainless steel pins. Upper rod has bronze sleeve where it passes through housing O-rings.

EPOXY PRIMER AND POLYURETHANE COATING SYSTEM

Upper barrel is provided with an E-coat primer and a two-part polyurethane top coat for improved durability, color and gloss retention.

STAINLESS STEEL HYDRANT SPRING

Industry's only positive compression drain ensures closure within approximately three turns.

DRAIN LEVER

Rugged bronze lever performs dual function as carrier for drain lever pads and as wrench to remove working parts.

BASE BOLTS AND NUTS

Hydrant is provided with stainless steel fasteners below grade.

HYDRANT SEAT

Seat is constructed of bronze. Design includes a near-vertical machined seating surface with two drain ports.

HYDRANT VALVE

EPDM hydrant valve is retained by epoxy-coated iron top and bottom. The all-bronze, near-vertical seat design minimizes trapping of debris.

WEATHER COVER

The word "OPEN" and an arrow show direction to turn the operating nut. The rubber weather shield helps prevent water and debris from entering the housing area.

THRUST WASHER

Takes upward thrust when opening hydrant valve and reduces operating torque.

HOUSING AND HOUSING COVER

Retains operating nut and thrust washer. Rugged construction helps withstand operating forces.

NOZZLES

Exclusive design eliminates the use of hard to remove threaded barrel designs and the need to use nozzle retention pins or set screws that may become dislodged or lost.

UPPER BARREL

Ductile iron with markings identifying size, model and year of manufacture.

TRAFFIC FEATURE

Upper barrel is connected to lower barrel with breakable traffic flange and eight bolts and nuts. This feature allows 360° rotation of upper barrel.

LOWER BARREL


The ductile iron lower barrel provides extra strength against traffic impact damage.

HYDRANT DRAIN SYSTEM


Drain ring is securely held between barrel and base flange, provides bronze-to-bronze threaded connection for hydrant seat. Hydrant is equipped with four drain outlets.

BASE

Ductile iron spherical base has no projections or cavities to restrict flow.

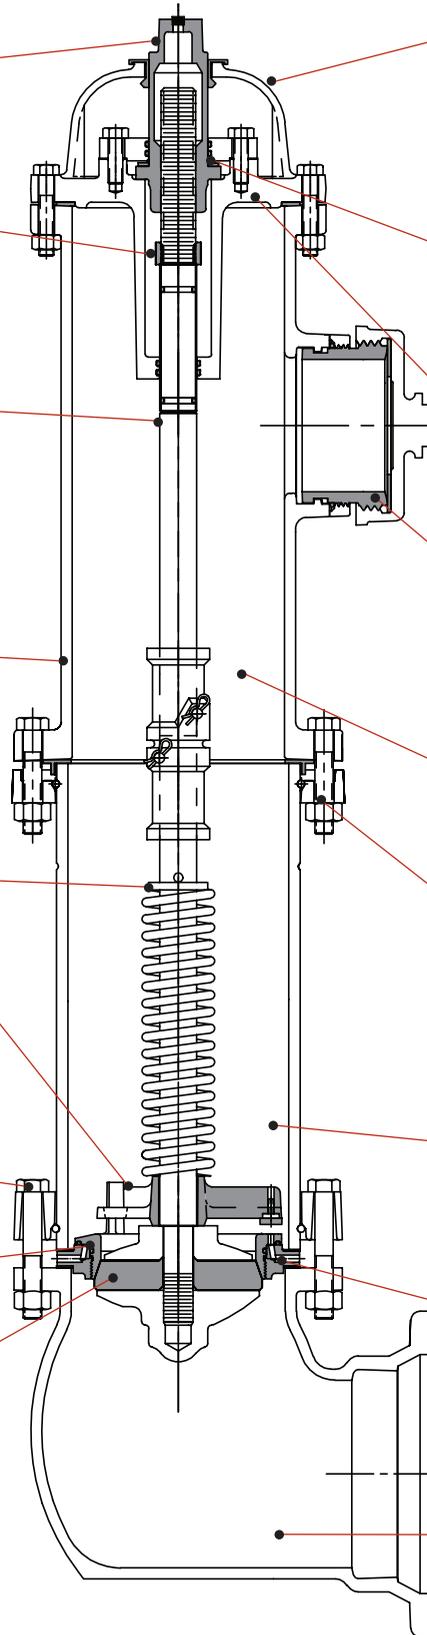

EXPLODED DRAWINGS

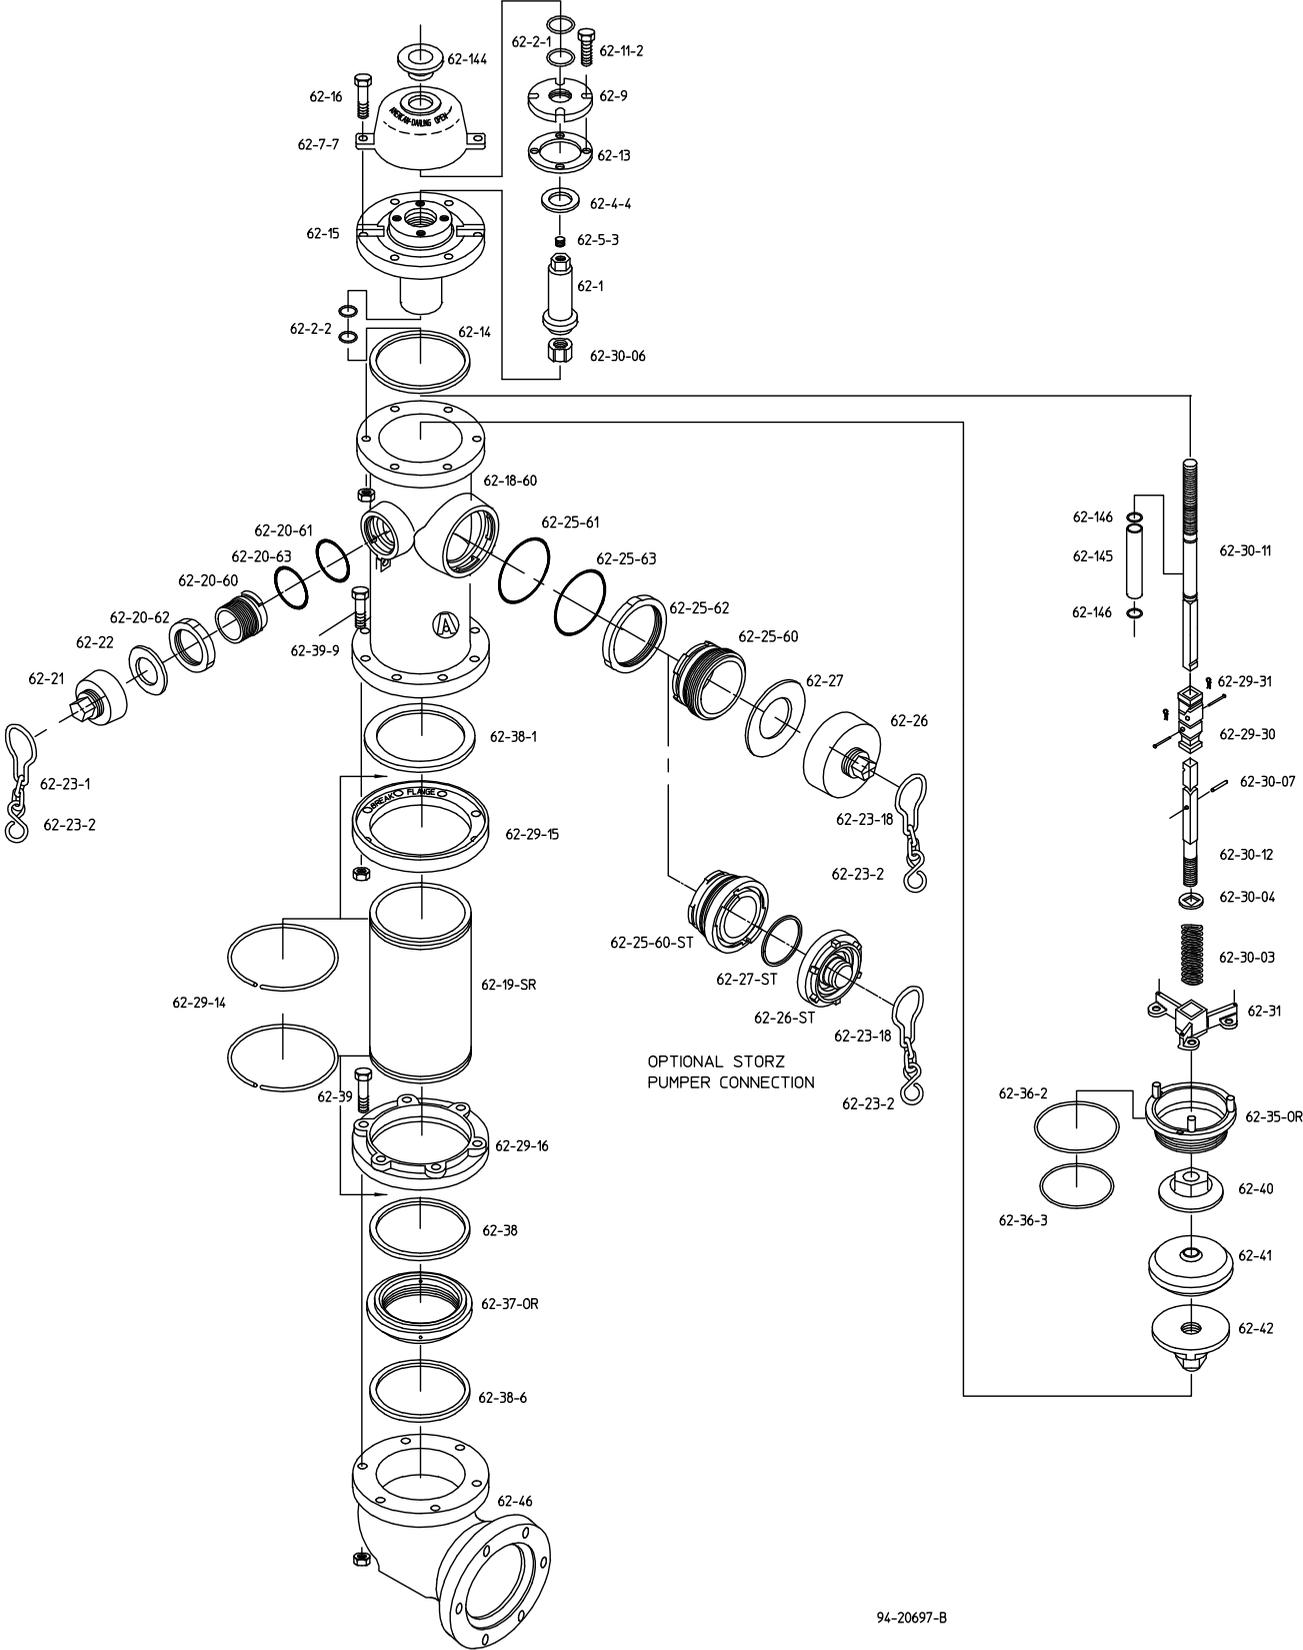

5-1/4" AMERICAN-DARLING B-62-B-5 FIRE HYDRANT

PARTS LIST

REF NO.	QTY.	DESCRIPTION	MATERIAL
62-1	1	Operating Nut	Bronze
62-2-1	2	Cover O-ring	Buna-N
62-2-2	2	Housing O-ring	Buna-N
62-4-4	1	Thrust Washer	Nylatron
62-5-3	1	Pipe Plug	Stainless Steel
62-7-7	1	Weather Cover	Gray Iron
62-9	1	Housing Cover	Gray Iron
62-11-2	4	Housing Cover Cap Screw	Plated Steel
62-13	1	Housing Cover Gasket	Fiber
62-14	1	Housing Gasket	Rubber
62-15	1	Housing	Ductile Iron
62-16	6	Housing Bolt and Nut	Plated Steel
62-18-60	1	Upper Barrel	Ductile Iron
62-19-SR	1	Lower Barrel	Ductile Iron
62-20-60	2	Hose Nozzle	Bronze
62-20-61	2	Hose Nozzle Seal	Buna-N
62-20-62	2	Hose Nozzle Retainer	Ductile Iron
62-20-63	2	Hose Nozzle Retainer Washer	Teflon
62-21	2	Hose Cap	See Note 7
62-22	2	Hose Cap Gasket	Rubber
62-23-1	1	Hose Cap Chain	Steel
62-23-2	3	S-Hook	Steel
62-23-18	1	Pumper Cap Chain	Steel
62-25-60	1	Pumper Nozzle	Bronze
62-25-60-ST	1	Storz Nozzle	Bronze/Aluminum
62-25-61	1	Pumper Nozzle Seal	Buna-N
62-25-62	1	Pumper Nozzle Retainer	Ductile Iron
62-25-63	1	Pumper Nozzle Retainer Washer	Teflon
62-26	1	Pumper Cap	See Note 7
62-26-ST	1	Storz Nozzle Cap	Aluminum
62-27	1	Pumper Cap Gasket	Rubber
62-27-ST	1	Storz Cap Gasket	Rubber
62-29-14	2	Snap Ring	Stainless Steel
62-29-15	1	Breakable Flange	Gray Iron
62-29-16	1	Base Flange	Ductile Iron
62-29-30	1	Rod Coupling	Gray Iron
62-29-31	2	Coupling & Clip Pins	Stainless Steel
62-30-03	1	Hydrant Spring	Stainless Steel
62-30-04	1	Spring Plate	Stainless Steel
62-30-06	1	Travel Stop Nut	Bronze
62-30-07	1	Spring Plate Pin	Stainless Steel
62-30-11	1	Upper Hydrant Rod	Steel
62-30-12	1	Lower Hydrant Rod	Steel
62-31	1	Drain Lever	Bronze
62-35-OR	1	Hydrant Seat	Bronze
62-36-2	1	Seat O-ring -Outside	Buna-N
62-36-3	1	Seat O-ring-Inside	Buna-N
62-37-OR	1	Drain Ring	Bronze
62-38	1	Drain Ring Gasket	Composition Rubber
62-38-1	1	Barrel Gasket	Rubber
62-38-6	1	Base Gasket	Composition Rubber
62-39	8	Base Bolt and Nut	Stainless Steel
62-39-9	8	Barrel Bolt and Nut	Plated Steel
62-40	1	Hydrant Valve Top	Ductile Iron
62-41	1	Hydrant Valve	EPDM Rubber
62-42	1	Hydrant Valve Bottom	Gray Iron
62-46-2	1	Flanged Base	Ductile Iron
62-46-5	1	Mechanical Joint Base	Ductile Iron
62-46-TY	1	TYTON® Base	Ductile Iron
84-46-6AA	1	ALPHA™ Base	Ductile Iron
84-46-6AX	1	ALPHA™ XL Base	Ductile Iron
62-144	1	Weather Shield	Rubber
62-145	1	Rod Sleeve	Bronze
62-146	2	Sleeve O-ring	Buna-N

NOTES

1. Size and shape of nut on operating nut and cap, threading on nozzles and caps, and the direction of opening made to specifications.
2. Cap chains are not furnished unless specified.
3. Working pressure 250 psig, test pressure 500 psig.
4. Hydrant conforms to ANSI/AWWA C502 standard.
5. Upper barrel can be rotated 360°.
6. UL Listed and FM Approved in allowable configurations.
7. National Standard and other common cap configurations are constructed of ductile iron. Other offerings may be constructed of gray cast iron.
8. Nominal turns to open is 19-1/2.
9. TYTON® is a registered trademark of United States Pipe and Foundry Co., LLC.
10. ALPHA™ is a licensed trademark of Romac Industries, Inc. (U.S. Patent 8,894,100)

AMERICAN Flow Control strongly recommends following routine maintenance on fire hydrants as outlined in AWWA Manual M-17 for Installation, Field Testing and Maintenance of Fire Hydrants. The ease of operation and the frequency of repair depends on the condition of the water system and the maintenance given. Dirt, gravel and other foreign material in the hydrant may prevent it from closing or draining properly, which may result in damage to the hydrant main valve. Under most operating conditions AMERICAN Flow Control recommends semiannual lubrication and inspection of fire hydrants.

5-1/4" AMERICAN-DARLING B-62-B-5 FIRE HYDRANT

FEATURES

The 5-1/4" American-Darling B-62-B-5 fire hydrant, by AMERICAN Flow Control® incorporates more than 100 years of experience in design, manufacture and field experience. This means dependable and efficient operation when needed.

The 5-1/4" American-Darling B-62-B-5 hydrant is rated at 250 psig and is tested at 500 psig. This hydrant meets or exceeds all requirements of ANSI/AWWA C502 for dry-barrel hydrants.

The 5-1/4" American-Darling B-62-B-5 is manufactured with the features you expect from a high-quality fire hydrant. The all-bronze seat and drain ring ensure that the 5-1/4" B-62-B-5 hydrant is easily serviced by just one person.

The 5-1/4" American-Darling B-62-B-5 fire hydrant is Certified to NSF/ANSI/CAN 61 and NSF/ANSI/CAN 372, which exhibit compliance with U.S Safe Drinking Water Act.

UL-FM

In applicable configurations, the 5-1/4" American-Darling B-62-B-5 hydrant is UL Listed and FM Approved. Both UL and FM Approvals require we consistently manufacture and test our hydrants in full compliance with their stringent standards. Our facilities are subject to periodic inspections to ensure we are in compliance with their standards.

5-1/4" American-Darling B-62-B-5 Standard Features:

- Upper barrel is furnished with an E-coat primer and a two-part polyurethane top coat for durability, gloss and color retention
- Ductile iron upper barrel, lower barrel, base and housing
- Easy 360° rotation of nozzle section
- 250 psig rated working pressure
- Tested at 500 psig
- Retainer-style mechanically attached nozzles
- Stainless steel bolting below grade
- Bronze-to-bronze seating
- Square hydrant rod
- Travel stop nut located in top of hydrant
- Exclusive fast-closing positive compression drain design

BENEFITS

Spring-Loaded Multiport Drains

Four external drain outlets are standard on the 5-1/4" American-Darling B-62-B-5. The stainless steel rod spring helps assure drains close after approximately three turns of the operating nut. This important feature helps prevent washouts and erosion.

Square Hydrant Rod

Square hydrant rod allows for the use of a short, lightweight disassembly wrench by providing four points of contact between the rod and wrench during seat removal.

Retainer-Style Nozzle Retention Design

Proprietary design eliminates the use of hard to remove threaded barrel designs and the need to use nozzle retention pins or set screws that may become dislodged or lost.

Travel Stop Nut

Stop nut in the housing limits opening. This helps prevent rod buckling and damage to bronze components that may occur if excessive torque is applied in the full open position. This also protects interior base coating by preventing valve bottom from contacting base.

SPECIFICATIONS

Fire hydrants shall meet or exceed ANSI/AWWA C502, latest revision. Rated working pressure shall be 250 psig, test pressure shall be 500 psig, and hydrants shall include the following specific design criteria:

The main valve closure shall be of the compression type. Traffic feature to be designed for easy 360° rotation of upper barrel during field installation.

The main valve opening shall not be less than 5-1/4" and be designed so that removal of all working parts can be accomplished without excavating. The hydrant valve shall be constructed of EPDM rubber and have a vertical taper of 20° or less. The bronze seat shall be threaded into a bronze drain ring. The draining system of the hydrant shall be bronze and positively activated by the main operating rod. Hydrant drains shall close completely after no more than three turns of the operating nut. There shall be a minimum of three internal ports and four outlets to the exterior of the hydrant. Drain shutoff to be by direct compression closure. Sliding drains are not permitted.

Hydrant barrels shall be made of ductile iron. Nozzles shall be retained by collars. Threaded-in nozzles and nozzles using set screws are not allowed.

Hydrant upper barrel shall be factory coated with Electrodeposition (E-coat) epoxy primer and catalyzed two-part polyurethane top coating. Base shall be coated with fusion-bonded epoxy. All bolting below grade shall be 304 stainless steel.

Hydrant shall be UL Listed and FM Approved in applicable configurations. All hydrants are to be Certified to NSF/ANSI/CAN 61 and NSF/ANSI /CAN 372.

Friction loss not to exceed 3.0 psig at 1000 gpm through 4-1/4" pumper nozzle. Hydrants shall be equal to the 5-1/4" American-Darling B-62-B-5 by AMERICAN Flow Control®.



AMERICAN
FLOW CONTROL
THE RIGHT WAY

AMERICAN Flow Control

P.O. Box 2727
Birmingham, AL 35202-2727
Phone: 800-326-8051
Fax: 800-610-3569
Email: afcsales@american-usa.com

Waterous Company

125 Hardman Avenue South
South St. Paul, MN 55075-1191
Phone: 888-266-3686
Fax: 800-601-2809
Email: afcsales@american-usa.com

WWW.AMERICAN-USA.COM

Distributed By:



B-62-B-5 Product Information

Product literature may become outdated. AMERICAN is not responsible for out-of-date information, errors or omissions.
Please contact AMERICAN for the most current product information.